


## PROTHERM 300 Standard

## Possible Peripherals

Digital inputs:

- 1 = Manual/Automatic
- 2 = Program Start
- 3 = Program RST
- 4 = Program Stop
- 5 = Dig. 1

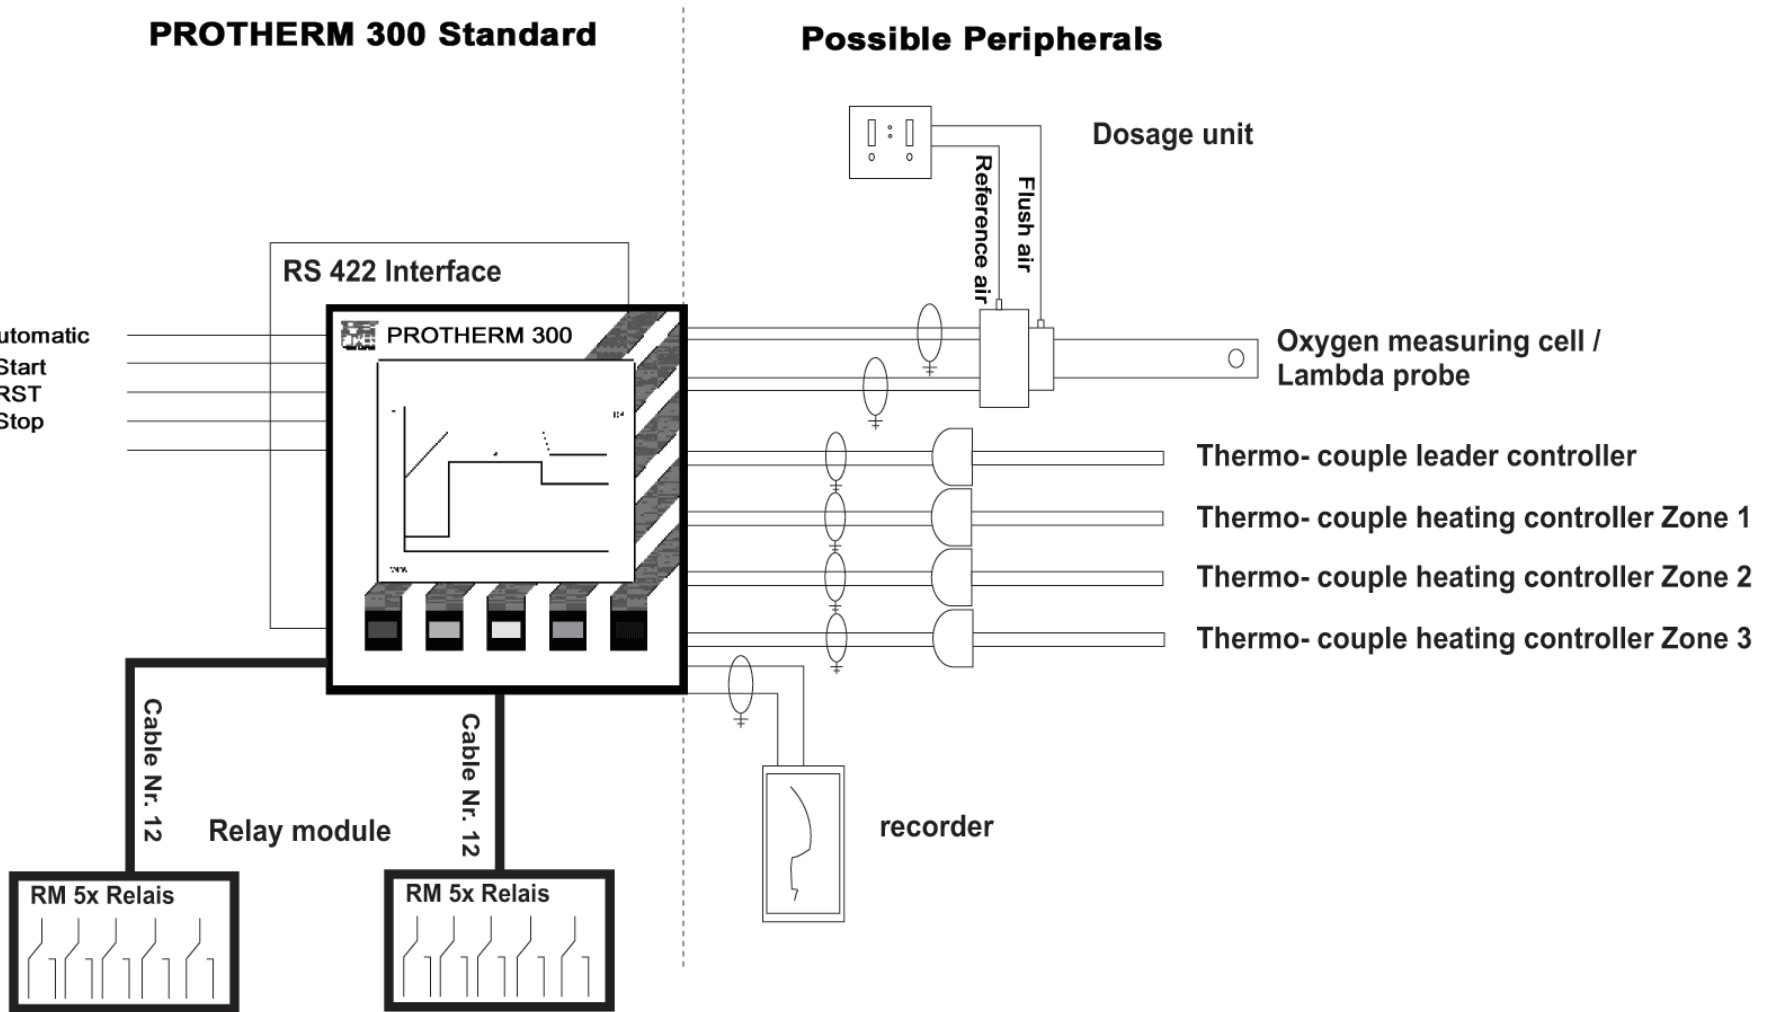

Example of the relay layout:

- 1 = Sensor cleaning
- 2 = NH3 relay
- 3 = air bolt
- 4 = CP limit value
- 5 = Temp. limit value

Example of a relay layout:

- 1 = CP open (MGV carburizing gas)
- 2 = CP close (MGV air)
- 3 = Temp. (Heating Zone 1)
- 4 = Temp. (Heating Zone 2)
- 5 = Temp. (Heating Zone 3)